




LAFAYETTE FIRE DEPARTMENT

FIRE HYDRANT CLEARANCE REQUIREMENTS

Indiana Fire Code

508.5.5 Clear space around hydrants. A 3-foot (914 mm) clear space shall be maintained around the circumference of fire hydrants except as otherwise required or approved. Fire hydrants shall be maintained unobstructed in accordance with **508.5.4.**

Note. Specific situations may require additional clearance.

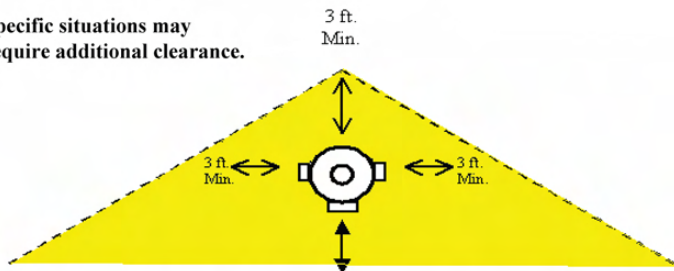


Must be unobstructed within the dashed line triangle area to the roadway.

Roadway

A HYDRANT SHALL NOT BE BURIED BY LANDSCAPING. A MINIMUM OF 18" CLEARANCE SHALL BE MAINTAINED BETWEEN THE CENTER OF THE 5 1/4" CAP AND FINISH GRADE.

REFER TO LAFAYETTE CITY STANDARDS & GUIDELINES FOR SPECIFIC INSTALLATION DETAILS.

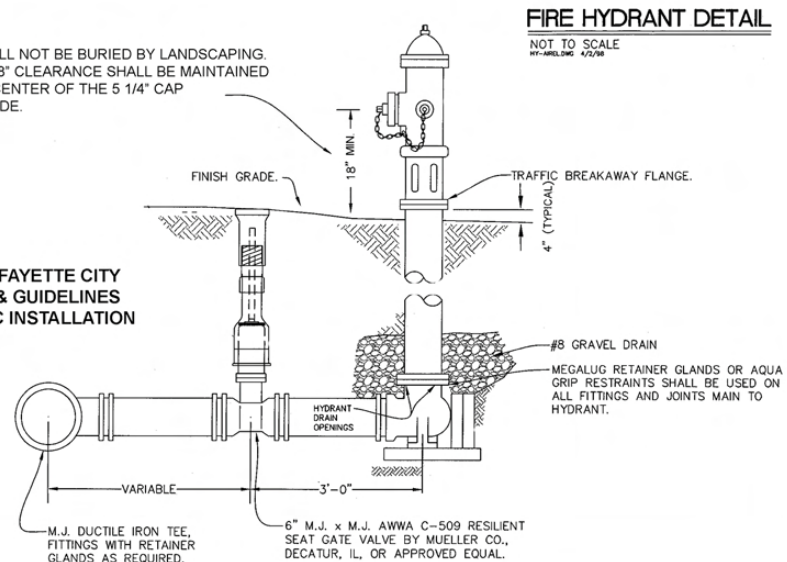

A hydrant shall not be obstructed or obscured by landscaping, fencing, debris or any other object.

This handout is intended as a guide. It is by no means all-inclusive or has all code related sections listed. If you have questions regarding this information please contact the Lafayette Fire Prevention Bureau at 807-1600 or LFD-FirePrevention@lafayette.in.gov

